



EU DECLARATION OF CONFORMITY
DECLARACIÓN UE DE CONFORMIDAD

3EBasor

CABLE TRAY SPECIALIST

www.basor.com



Certificado Nº SGI 3198055/11



Certificado Nº SGI 3198065/12

The company / *La Empresa:*

BASOR ELECTRIC, S.A.

Address / *Dirección:*

Av. Alcodar, 45-47, 46700. Gandía (VLC), Spain.

Declares that the product:

Declara que el producto:

BASORSUPPORT C-SR

Installed in accordance to the installation standards, manufacturer's instructions and professional rules, duly maintained and used for the applications as intended.

Instalado de acuerdo con las normas de instalación, instrucciones del fabricante y conforme a las reglas profesionales, debidamente mantenido y utilizado en las aplicaciones para las que está previsto.

Complies with the essential requirements of the Council Directives:

Cumple con los requisitos esenciales de las Directivas del Consejo:

2014/35/UE (Low Voltage Directive) / (Directiva de Baja Tensión)

Incorporated in the Spanish Legislation in: R.D. 7/1988 and its modification R.D. 154/1995.

Incorporado en la Legislación Española en: R.D. 7/1988 y su modificación R.D. 154/1995.

And it is suitable and safe for the intended use and it is in conformity with the following standard:

Es adecuado y seguro para el uso a que está destinado y es conforme con la siguiente norma:

UNE EN 61537

Additional information:

Información adicional:

This product is intended to be installed and maintained by skilled persons, it may be used by ordinary persons only as a replacement part, to substitute for an identical device.

Este producto está previsto para ser instalado y mantenido por un profesional, puede ser usado por una persona no formada para reemplazamiento de uno idéntico.

Place and date:

Lugar y fecha:


Gandía April 2016

Gandía Abril 2016

Technical department / *Departamento Técnico*



C-SR HORIZONTAL SUPPORT

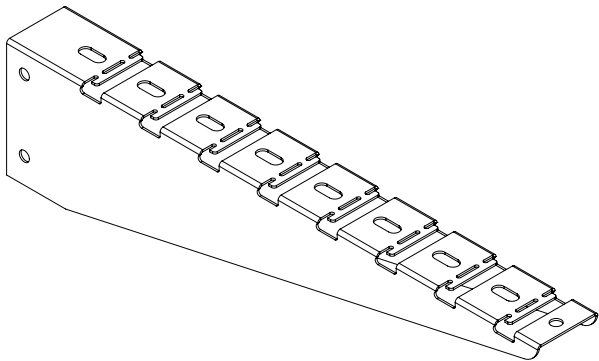

Models (B):

100; 150; 200; 300; 400; 500; 600.

Finishes: HDG, ss304, ss316

Characteristics:

- Metallic
- Non-flame propagating
- System with electrical continuity
- Electrically conductive component
- Minimum temperature of -50 °C
- Maximum temperature of 150 °C
- With metallic coating; resistance to corrosion:


HDG coating: class 6

ss304: clase 9A

ss316: clase 9B

ASSEMBLING INSTRUCTIONS

C-SR+CARTELA KSR

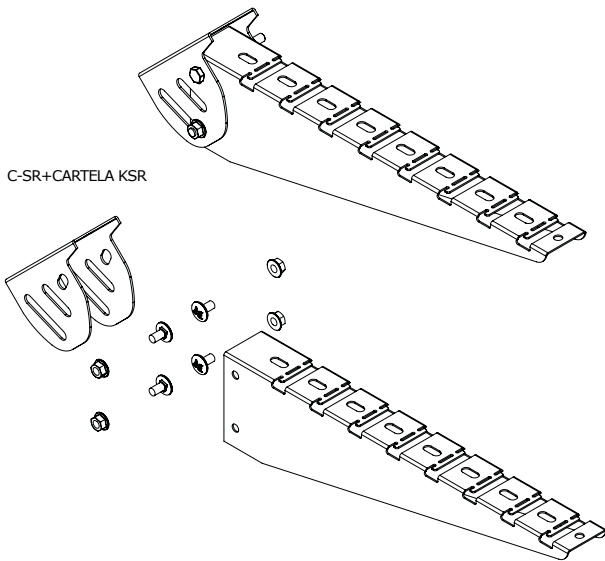

- To set up with the KSR wall bracket 1 CT2 M8x75 pin set and 2 B2 bolt sets, or 4 B2 bolt sets are needed. This assembly allows angles to 50° for 200-300 models and to 45° for 400-600 models.

- To set up with the C-PC profile 2 CT2 M8x75 pin sets are needed.

- The tray installation for an electrical system should NOT run under other types of canalisation such as water, vapour or gas canalisation.

- To guarantee a good ventilation, we recommend installing the trays keeping a minimum distance of 250 mm between each tray.


- Trays which are placed on supports shall have to keep a gap of 20 mm from the wall to allow for a correct ventilation of the cables.

- It is used as horizontal support for the following trays: ERE, MRE, FRE, BF and BFR.


- To set up the trays ERE, MRE and FRE B1 Sets are used.

- To set up the trays BASORFIL there is no need of using hardware. One of the clicks can be pressed with a flat screwdriver.


MOD. 100-300



MOD. 400-600



C-SR+C-PC

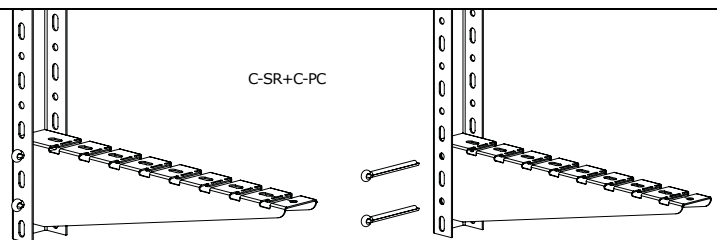

SAFE WORKING LOAD

